



8 7 6 5 4 3 2 1

OUTLINE FOR ASCO® 300 SERIES 600 AMPERE "J" FRAME (J3ATS,J3NTS,J3ADTS,J3NDTS) FRONT CONNECTED TRANSFER SWITCHES TYPE 1 ENCLOSURE


LEFT SIDE
WITH DOOR

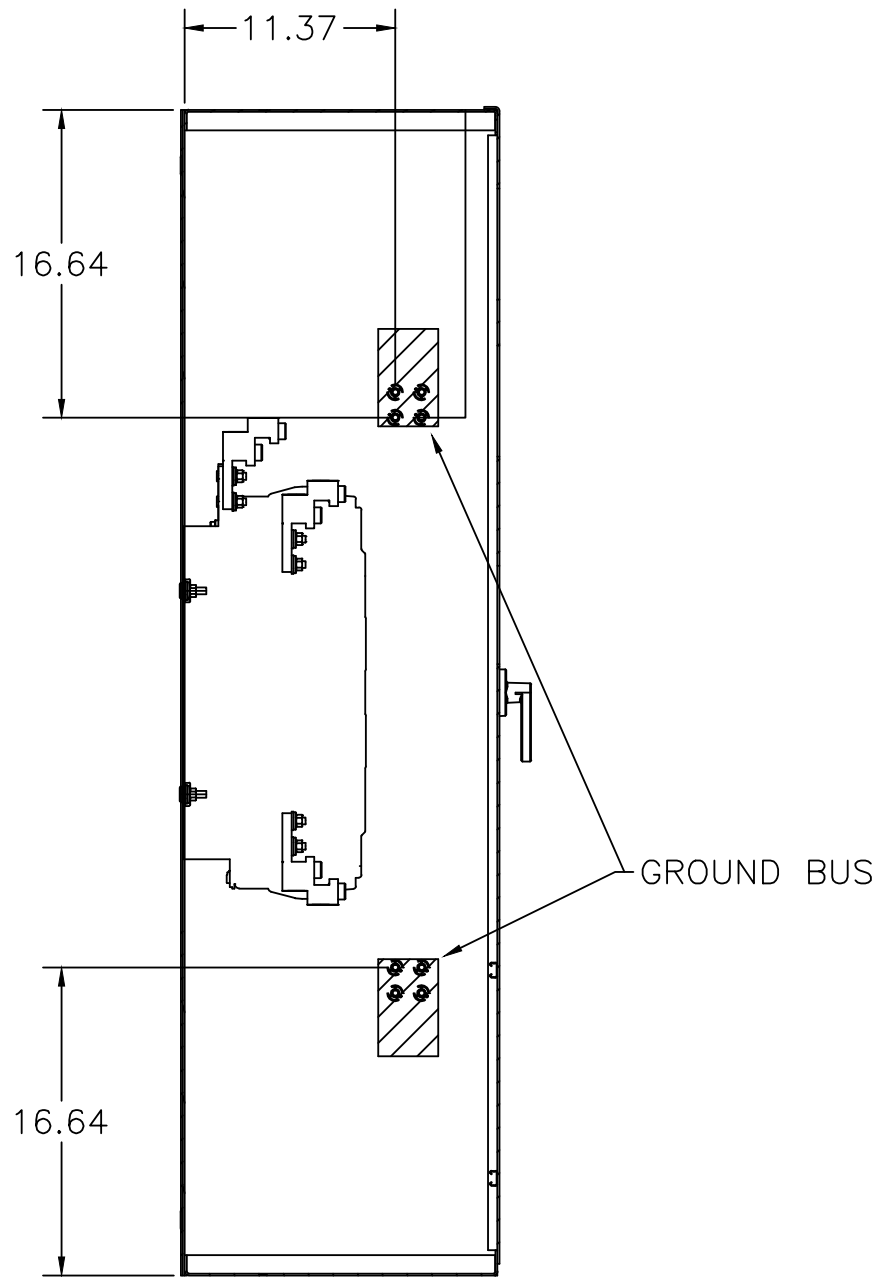


FRONT VIEW
WITHOUT DOOR

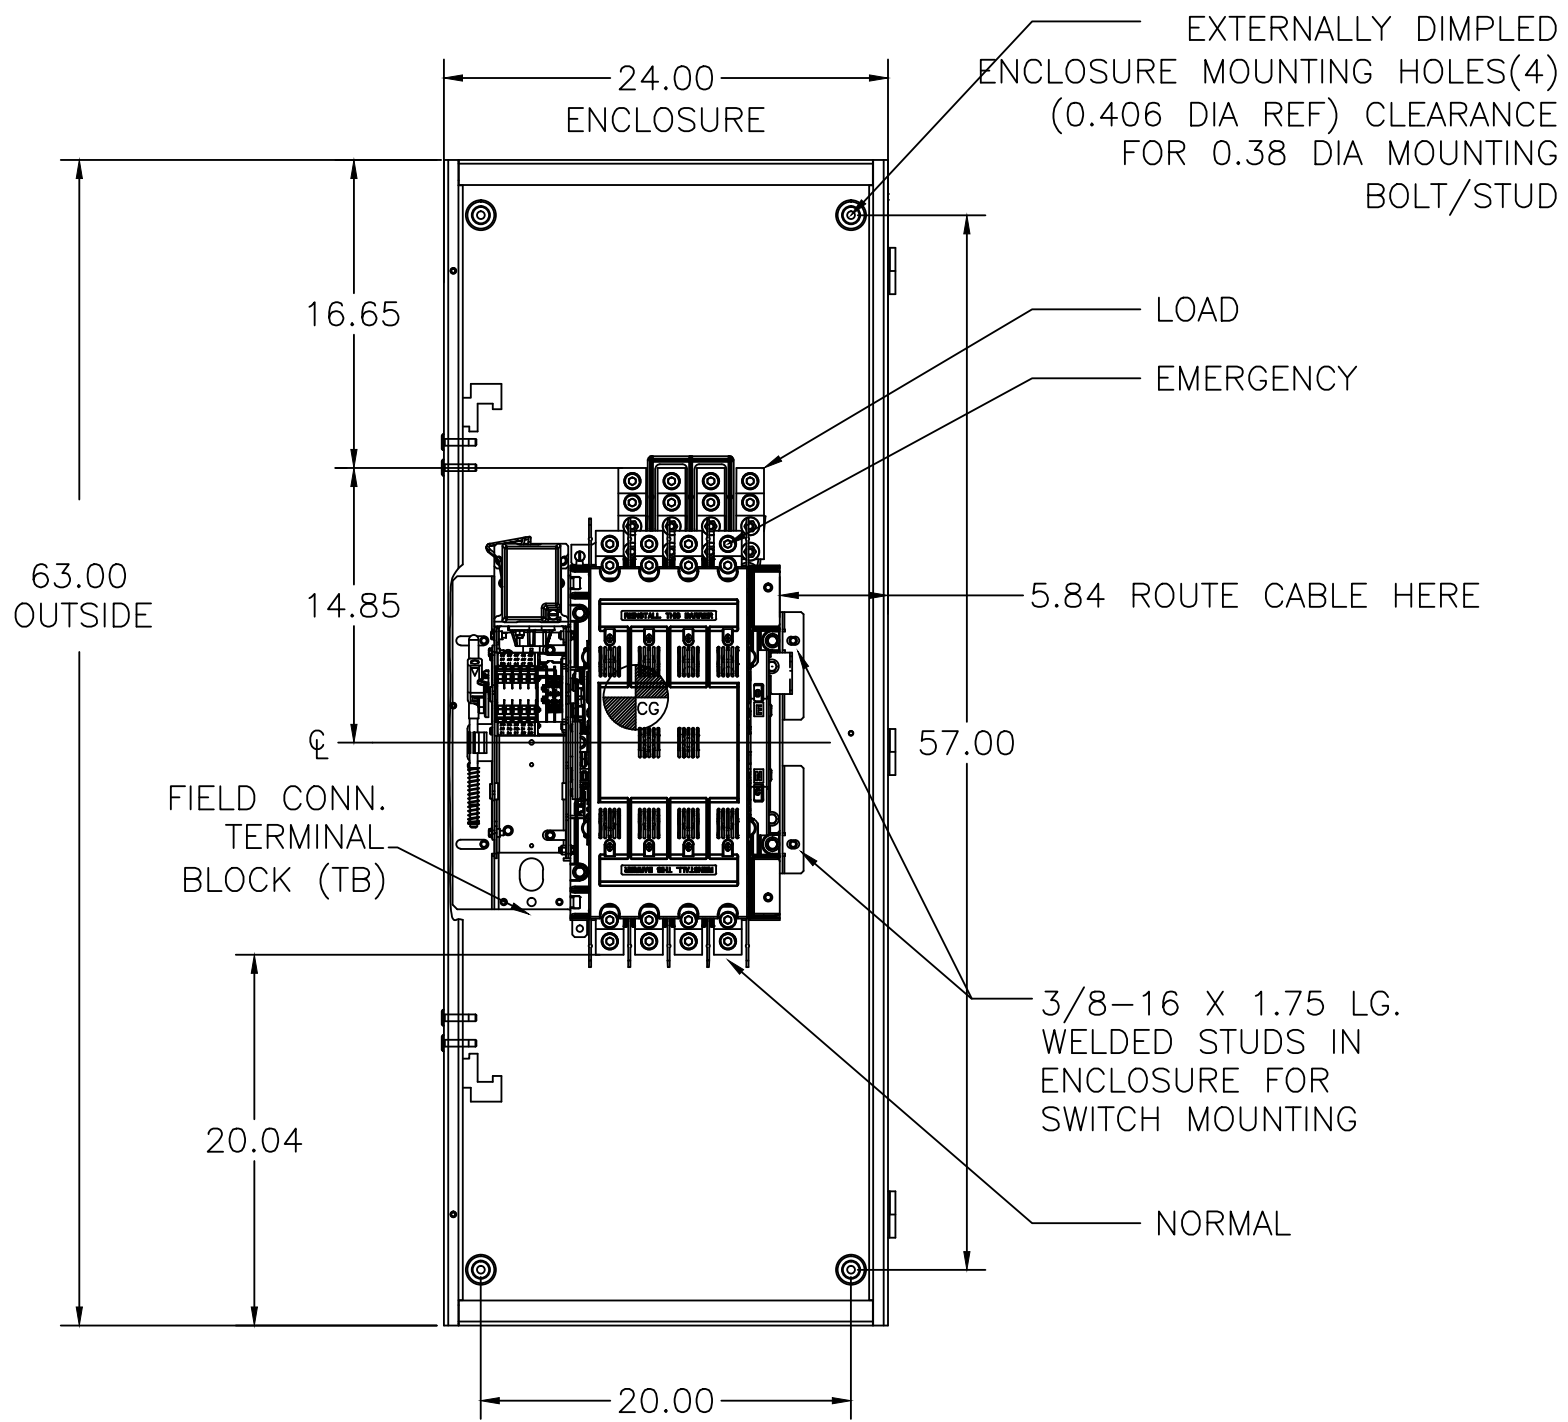

RIGHT SIDE
WITH DOOR

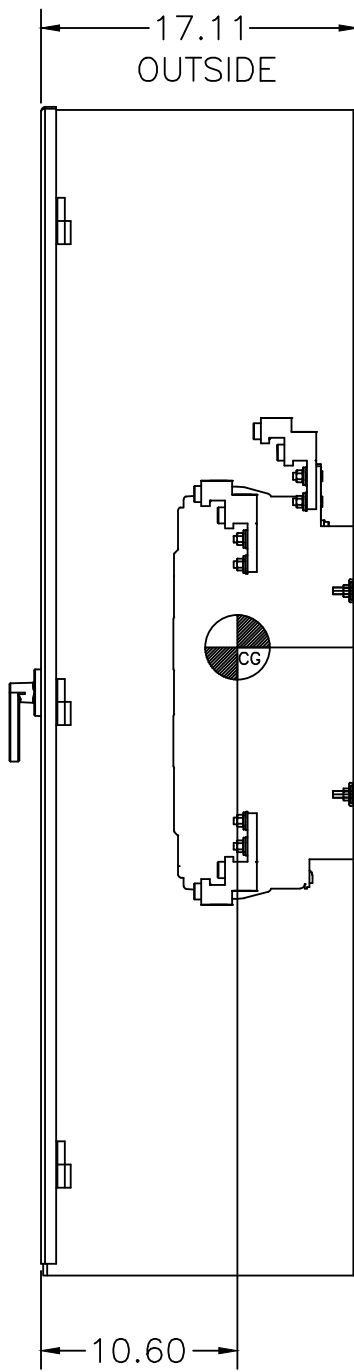

FRONT VIEW
WITH DOOR

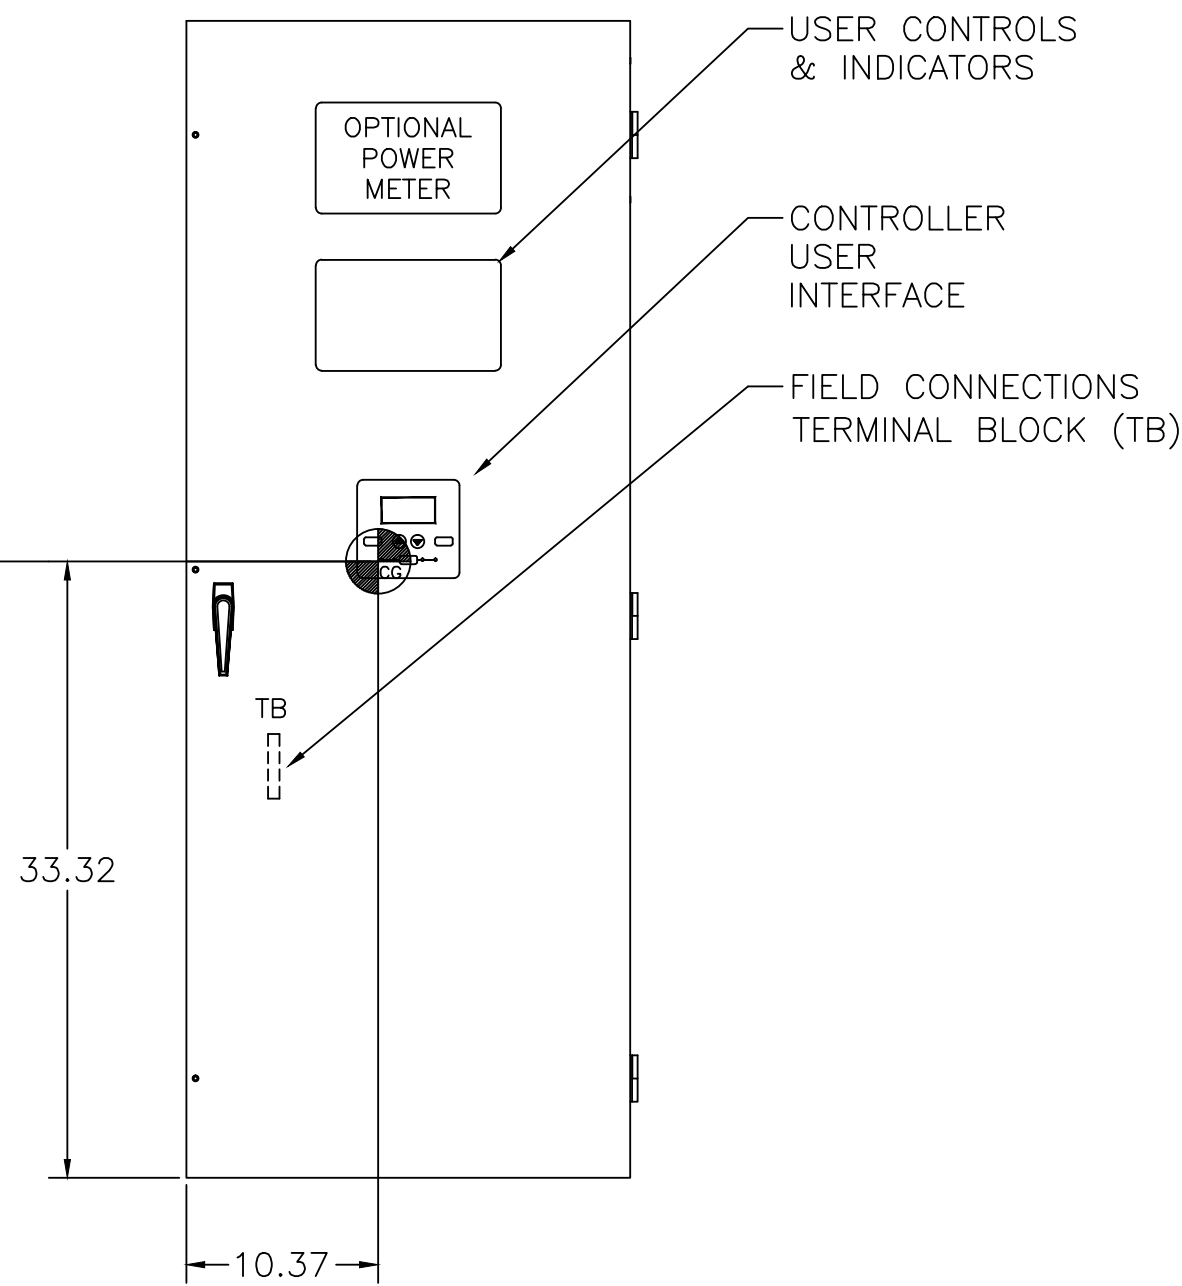

GENERAL NOTES


- TYPE 1 ENCLOSURE. FREE STANDING. FLOOR MOUNTED OR WALL MOUNTED. 12 GAUGE CONSTRUCTION.
- NEC STANDARD GAUGE PAN TYPE DOOR WITH LOCKABLE HANDLE.
- FINISH: ANSI 61 GRAY, POLYESTER POWDER STANDARD. OTHER ANSI COLORS AVAILABLE CONSULT FACTORY UL RECOGNIZED.
- RECOMMENDED CLEARANCES:
FRONT: 24 INCHES
- A 20% RATED GROUND BUS IS PROVIDED.
- UNIT IS DESIGNED FOR COMBINATION TOP AND BOTTOM CABLE ENTRY.
- A FULL RATED NEUTRAL CONNECTION FOR EACH SOURCE AND THE LOAD IS OPTIONAL. WHEN PROVIDED IT IS IN ONE OF THE FOLLOWING FORMATS AS SPECIFIED BY THE CATALOG NO. NEUTRAL TYPE;
A. SOLID (COPPER BUS) NEUTRAL
B. SWITCHED NEUTRAL POLE
-  CENTER OF GRAVITY.

CABLING NOTES

- ALL SIZES SUPPLIED STANDARD WITH MECHANICAL (SCREW TYPE) LUGS. (SEE AMP SIZE BELOW)
A. LUG MATERIAL: ALUMINUM ALLOY 6061-T6 WITH ELECTRO TIN PLATED FINISH.
B. SCREW MATERIAL: ALUMINUM ALLOY 6262-T9 WITH ELECTRO TIN PLATED FINISH.
C. UL LISTED, CSA CERTIFIED.
D. LUG SCREW TIGHTENING TORQUE PER UL 486B: 19 FT-LBS.
E. SUITABLE WIRE BENDING SPACE IS PROVIDED. (SEE AMP SIZE BELOW)
- GROUND LUGS ARE PROVIDED STANDARD AS FOLLOWS. (SEE AMP SIZE BELOW)

NOTES 600 AMP SWITCHES

- SUPPLIED WITH STANDARD MECHANICAL (SCREW TYPE) LUGS ON THE NORMAL, EMERGENCY & LOAD BUS STABS. ONE (1) LUG PER PHASE AND NEUTRAL EACH SUITABLE FOR CONNECTION OF TWO (2) #2 -600MCM CU/AL CABLES.
A. SUITABLE WIRE BENDING SPACE IS PROVIDED FOR UP TO TWO (2) 600MCM CABLE PER TERMINAL PER NEC.
- GROUND LUGS ARE PROVIDED STANDARD AS FOLLOWS;
SIX (6) #2 -600MCM CU/AL CABLE CONNECTIONS.

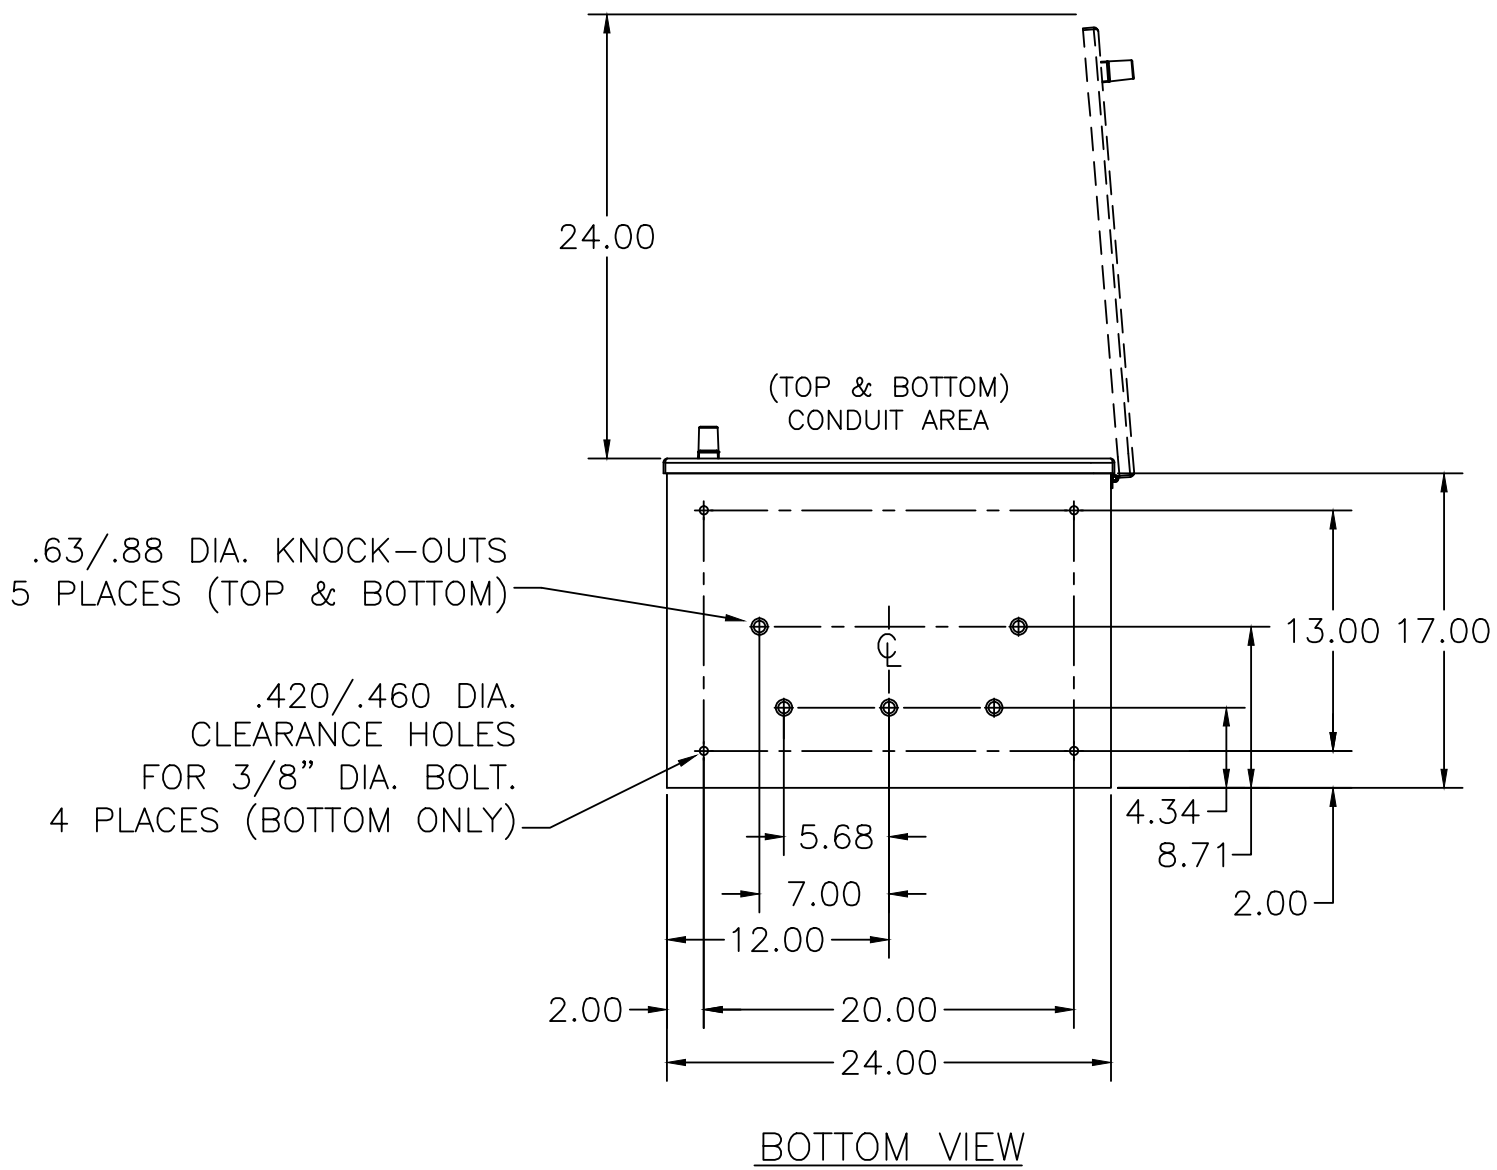

BOTTOM VIEW

PROJECT NAME:			245094			BWM			SDH			10/28/13		
COMPOSITE OUTLINE			ISSUED			BY			APP.			DATE		
300 SERIES TS "J"			REV. TO SHEET			ECN NO.			THIRD ANGLE PROJECTION					
600 AMP TYPE 1			DRAWN BY			BWM			DATE			10/28/13		
CHECKED			PROJECT APPROVAL			FINAL APPROVAL			SDH			10/28/13		
MANUFACTURING TOLERANCES TO BE IN ACCORDANCE WITH ASCO PROCEDURE MP-1-003. FOR PLASTIC PARTS SEE MP-1-055.			ASSEM. REF. NO.			COMPUTER GENERATED DRAWING			SCALE			NONE SIZE DS		
PROPERTY OF ASCO POWER TECHNOLOGIES. USE PERMITTED FOR OUR WORK ONLY. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.			DWG. NO.			1001393-001			DRAWING REV.			ECN NO. 245094 SHEET 1 OF 1		
ASCOPower Technologies, L.P. FLORHAM PARK, NEW JERSEY 07932 U.S.A.			ASCOPower Technologies, L.P. FLORHAM PARK, NEW JERSEY 07932 U.S.A.			ASCOPower Technologies, L.P. FLORHAM PARK, NEW JERSEY 07932 U.S.A.			ASCOPower Technologies, L.P. FLORHAM PARK, NEW JERSEY 07932 U.S.A.			ASCOPower Technologies, L.P. FLORHAM PARK, NEW JERSEY 07932 U.S.A.		